





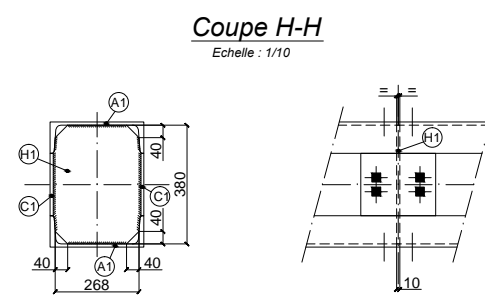


Nuance d'acier : E36
Type de protection : Galvanisation a chaud

Poutre type 2

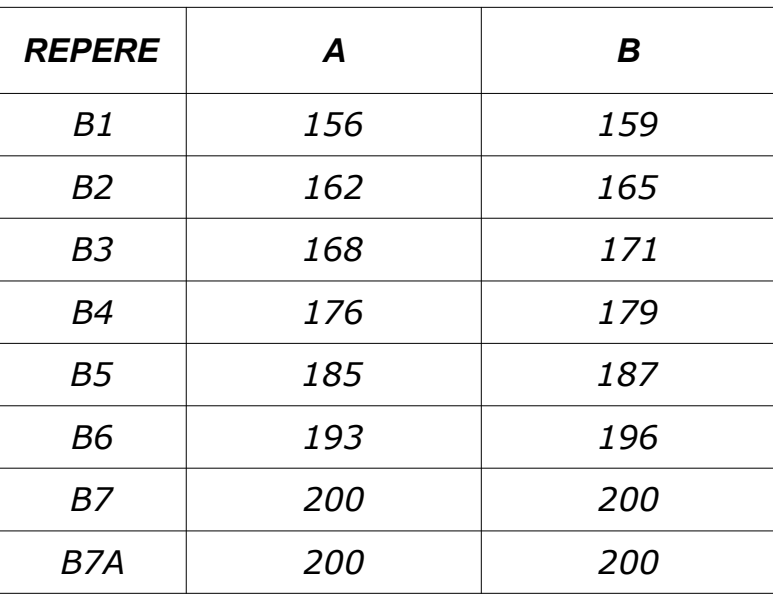

L E G E N D E	
ITEM	DESIGNATION
	TROU Ø22 - BOULON H M20x80 + RONDELLE M20N (Fixation poteau / poutre)
	TROU Ø26
	TROU Ø16
	TROU Ø16 (M.A.L.T)
	TROU Ø10

ROYAUME DU MAROC	المملكة المغربية
OFFICE NATIONAL DE L'ELECTRICITE ET DE L'EAU POTABLE	المكتب الوطني للكهرباء والماء الصالح للشرب
Direction Ingénierie et Réalisation Projets Transport	مديرية هندسة وتنفيذ مشاريع خطوط النقل
Division Ingénierie Transport	قسم هندسة شبكة النقل
Service Ingénierie Postes	مصلحة هندسة المحطات

PORTIQUE D'ANCRAGE TENDUES
INTERMEDIAIRES 225 KV
- POUTRE-

ONE/DD/DIT/IT/PO				Echelle		Date		Dessiné		Verifié		Validé			
BON POUR EXECUTION				4/1				HAMANI		SLAOUI		EL OMARI			
				N° : ٢٣٢ CHP-THT 225 KV -04								Modification			
												A B C			
Nom		Resp.HT		Chef Service		Chef Division									
Visa															